



Floor Plan

3.06.05 C Tub/Shower Room

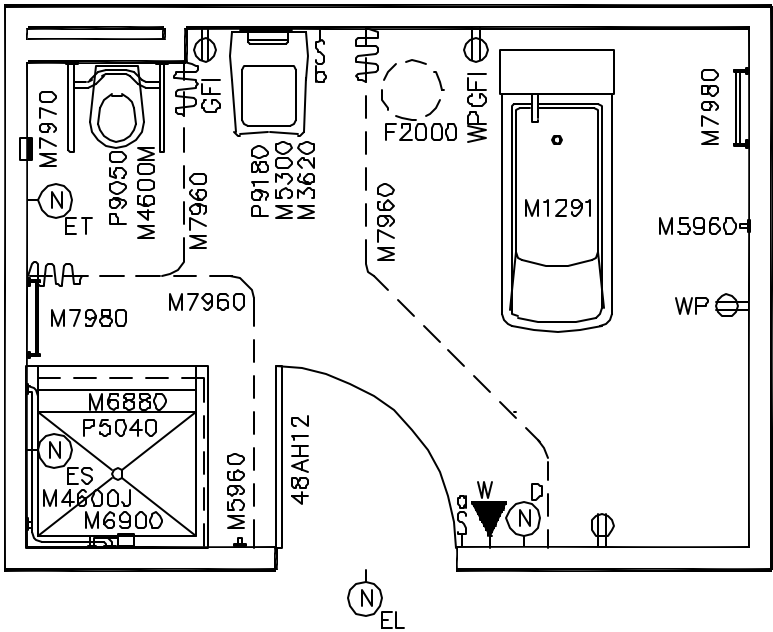


JULY 1988




Reflected Ceiling Plan

3.06.05 D
Tub/Shower Room

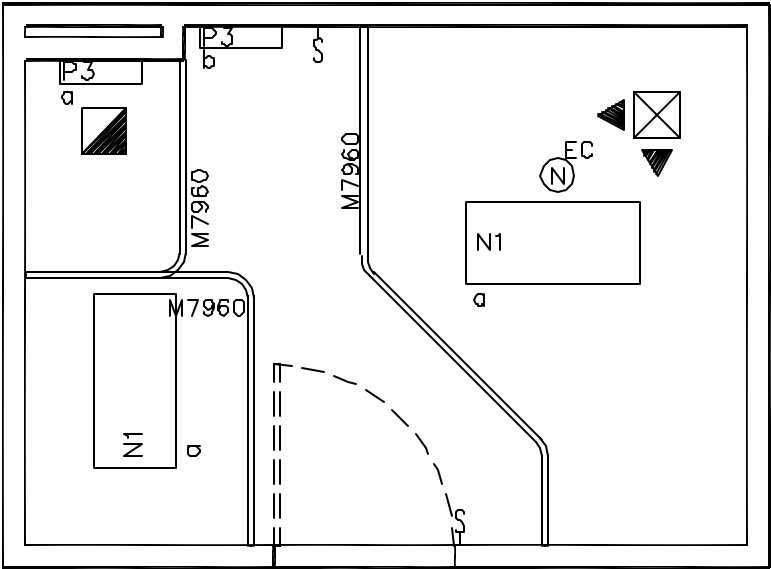


JULY 1988




Functional Diagram

3.06.05 B Tub/Shower Room

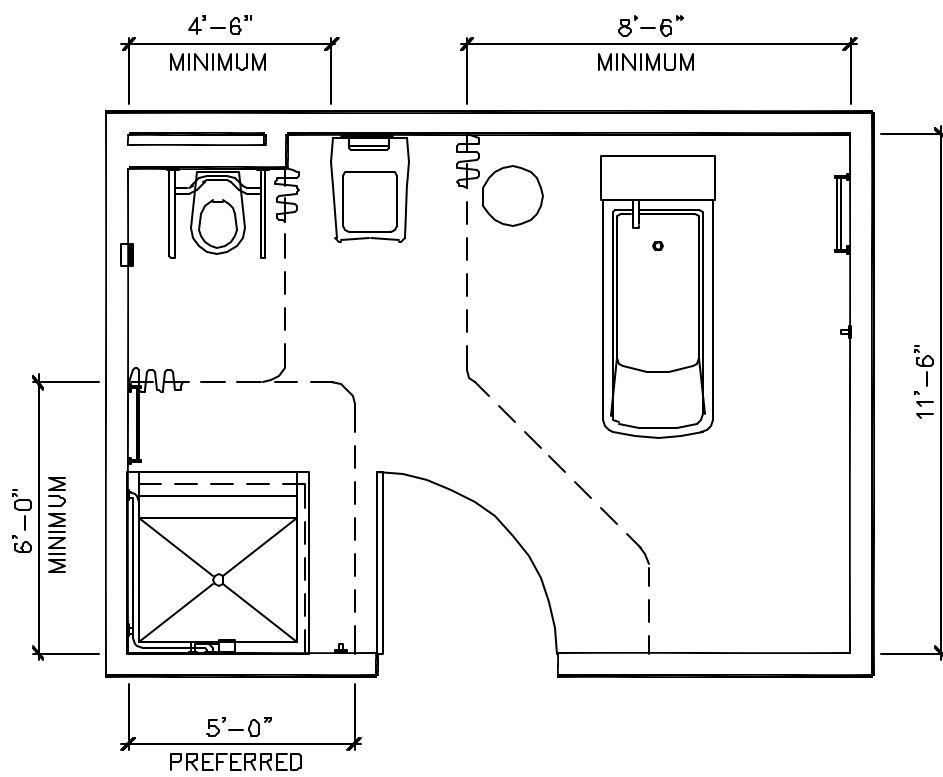


Composite Plan

3.06.05 E
Tub/Shower Room

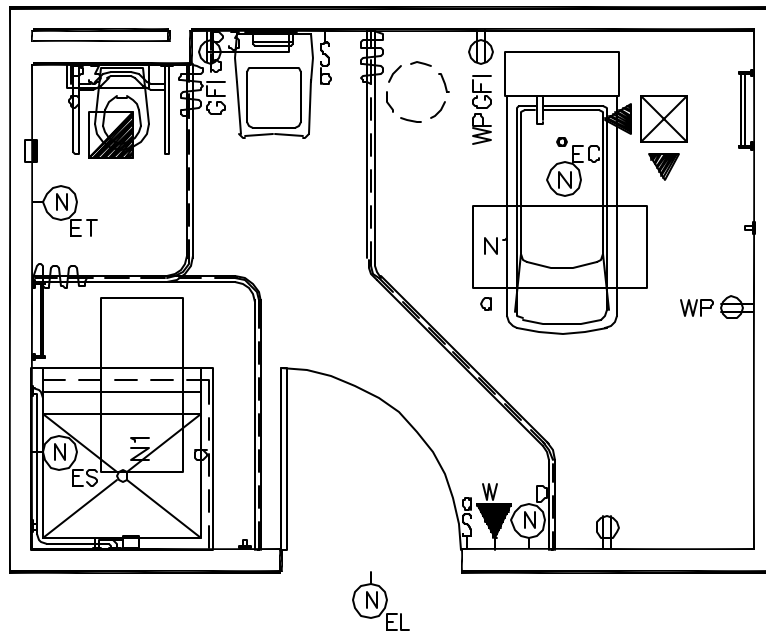

JULY 1988



Matrix Data

3.06.05 A Tub/Shower Room

ARCHITECTURAL/ACOUSTICS

Square Foot Area Net	-	180		
Finishes	-	Walls	-	CT
	-	Base	-	CT
	-	Floor	-	CT
	-	Ceiling	-	GW-SG
Ceiling Ht	-	8'-0"		
Door Size & Type	-	48A		
Hardware Set	-	H12		
Ambient Noise Level	-	NC 35-40		
Speech Privacy Level	-	Normal		

Architectural Notes -

ELECTRICAL

Ambient Illum (FC)	-	20
Task Illum (FC)	-	-
Luminare Type	-	N1,P3
Switching	-	Std by Area

Electrical Notes -

MECHANICAL

Total Air Changes	-	6	
Outside Air Changes	-	1.5	
Room Pressure(%)	-	-10	
Temperature (F)	-	Sum 78	Win 75
Relative Hum(%)	-	30-60	
Exhaust Air	-	Yes	
Return Air	-	No	
Filtration(%)	-	25,80,0	

Mechanical Notes -

MECHANICAL PIPING

Cold Water	-	Yes
Hot Water	-	Yes
Treated Water	-	No
Chilled Water	-	No
Waste/Vent	-	Yes
Floor Drain	-	No
Steam	-	No
Condensate	-	No

Piping Notes -

EQUIPMENT PROGRAM

J.S.N. Code	Nomenclature	Qty	Log Cat
M1291	Bath, Hydraulic Lift	1	A
M3620	Dispenser, Paper Towel	1	A
M4600J	Grab Bar, Tub/Shower	1	A
M4600M	Grab Bar, Straddle	1	A
M5300	Mirror 14 X 20	1	A
M5960	Coat Hook	2	A
M6880	Shower Curtain & Rod	1	A
M6900	Soap Dish w/ Grab Bar	1	A
M7960	Track & Curtain, Cubicle	3	A
M7970	Toilet Paper Holder, Recessed	1	A
M7980	Towel Bar, 18"	2	A
P5040	Shower, Wheelchair	1	A
P9050	Water Closet	1	A
P9180	Lavatory, Wheelchair	1	A
F2000	Waste Receptacle, Off	1	C

COMMUNICATION PROGRAM

Commno Code	Nomenclature	Qty	Log Cat
NCOEC	Pullcord Station, Ceiling	1	A
NCOEL	Dome Light W/ Chime	1	A
NCOES	Pullcord Station-WP, Shower	1	A
NCOET	Pullcord Station, Emer	1	A
NC000	Duty Station	1	A
TLOOW	Wall Outlet-54" AFF	1	A

Matrix Data

3.06.05 A2
Tub/Shower Room

COMMUNICATION PROGRAM

Commo Code	Nomenclature	Qty	Log Cat
	X	1	X
	X	1	X
	X	1	X

MATRIX SHEET 2 SHOULD ONLY BE USED
IF REQUIRED BY MATRIX SHEET 1 CONTENT OVERFLOW